



City of Moorpark

Community Development Building and Safety
799 Moorpark Ave.
Moorpark, CA 93021
Ph: 805-517-6200

WINDOW AND DOOR REPLACEMENTS

RESIDENTIAL PROPERTIES

All window and exterior door replacements require a building permit. A simple floor and plot plan is required for review and permit issuance. Show existing windows and replacement window sizes and type. Replacement windows shall be exempt from maximum sill height requirements if the replacement window is the manufacturer's largest standard size window that will fit within the existing frame or rough opening and same operating style. **CRC 310.2.5**

MINIMUM WINDOW REQUIREMENTS

- All rooms used for sleeping purposes shall have one complying Escape/Rescue window meeting ALL the following minimum requirements. **CRC 310.2:**
 - Net clear openable space of 5.7 sq ft (5.0 sq ft min at grade floor openings)
 - Net clear openable height of 24 inches
 - Net clear openable width of 20 inches
 - Maximum finished sill height of 44 inches
- All habitable rooms shall have windows with their total areas equaling at least 8% or a minimum of the room's floor area and with their total openable area equaling at least 4% of the room's floor area **CRC 303.1.**
- All new windows and window replacements must meet the following minimum energy requirements:
 - U-factor – 0.30 Max
 - SHGC – 0.23 Max
- NFRC Labels are required to remain on windows for verification by the building inspector.
- Maintain or replace weather resistive barriers. Inspection is required to verify compliance.
- Bay windows and similar assemblies require the manufacturer's listed (UL, ICC, or equiv.) installation instructions for permit issuance.
- Safety glazing or tempered glass is required in hazardous locations per **CRC 308.4:**
 - Glazing in fixed, swinging, sliding & bifold doors.
 - Glazing in an individual fixed or operable panel adjacent to a door where the bottom edge of the glazing is less than 60" above the floor surface and meets either condition:
 - Glazing is within 24" of either side of door.
 - Glazing is on a wall less than 180 degrees from the plane of the door & within 24" of the hinge side of an in-swinging door.
 - Glazing in an individual fixed or operable window panel that meets all of the following:
 - Windows larger than 9 SF.
 - Bottom edge less than 18" above floor.

- "Identification. each pane of glazing installed in hazardous location as defined in Section **CRC 308.4** shall be provided with a manufacturer's designation that is visible in the final installation. The designation shall be acid etched, sandblasted, ceramic-fired, laser etched, embossed, or be of a type which once applied cannot be removed without being destroyed **CRC 308.1**.
- All exterior doors require an exterior light switched from inside **CEC 210.70(A)(1)**.
- Additional requirements when changing a window to a sliding door are **CRC 311.3**:
 - A landing is required. A minimum of 3 ft out and at least the door width.
 - A door may swing over a landing that is level with interior.
 - Exterior lighting required. A switch and weather-proof light with photocell and motion sensor is required outside each outdoor entrance or exit **CEC 210.70(A)(1)**.


Moving the electrical wiring and adding lighting will require an electrical permit.

INSPECTIONS:

- Framing and window flashing
- Stucco lath repair
- Rough electrical, if moving outlet or adding a switch and outside light prior to covering with insulation and/or drywall.
- Final inspection

NOTE:

Using both the minimum sizes for width and height will not obtain the required minimum area (5.7 sq ft; 5.0 sq ft at grade).

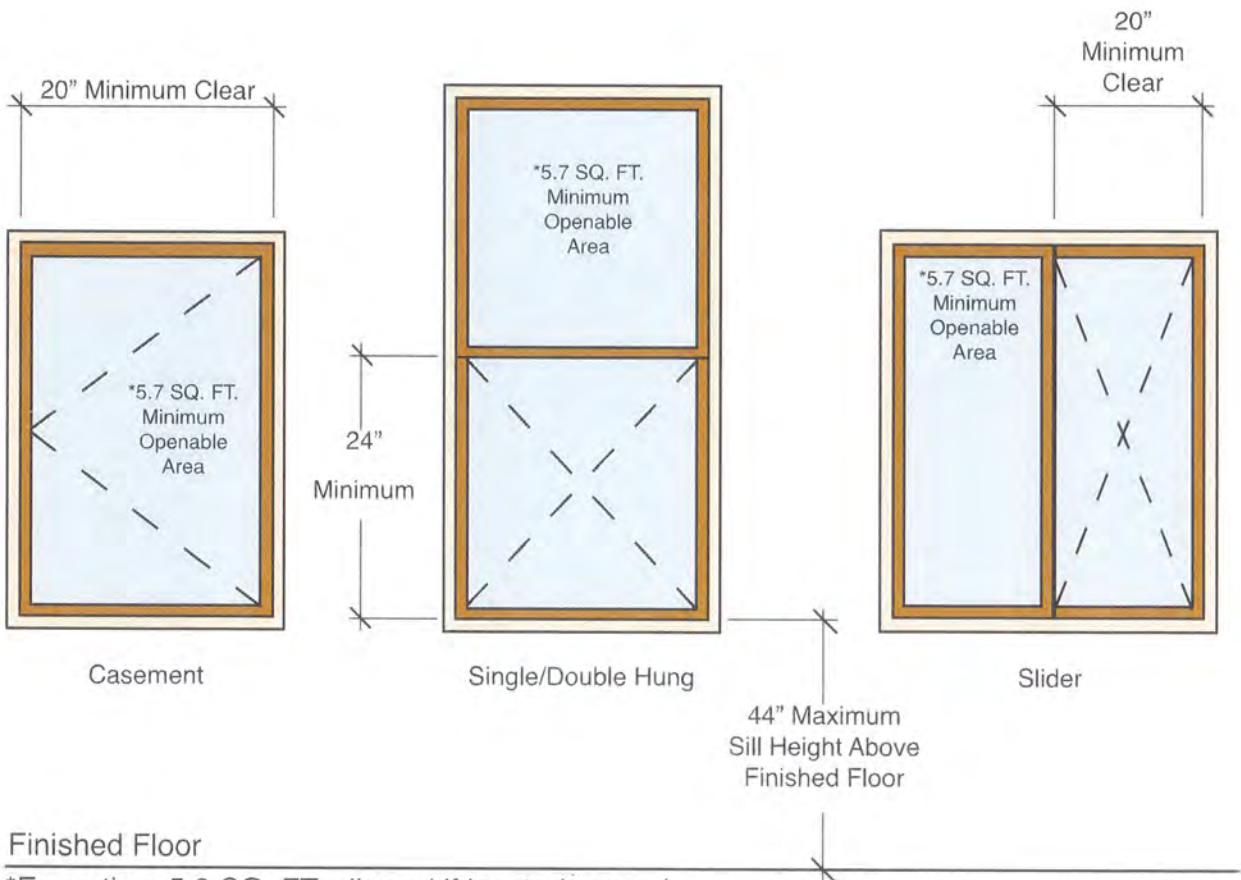


*Exception: 5.0 SQ. FT. allowed if located at grade.

INSTRUCTIONS:


Complete the table below noting the complete scope of work. The numbering system can be used to reference locations of proposed work on the plan. Use the the code information on the back of this sheet to verify that your proposed construction meets code requirements. If you need assistance see our "WINDOW REPLACEMENT- SAMPLE PLAN" handout or a permit technician.

WINDOW TYPES:

Casement
(CAS)




Single Hung
(SH)




Double Hung
(DH)



Slider
(SLDR)



Slider fixed
center panel
(SLDR XOX)



Fixed
(FIX)



WORKSHEET

ADDRESS _____ PERMIT # _____

	EXISTING WINDOW SIZE & TYPE	NEW WINDOW SIZE & TYPE	WINDOW AREA	LOCATION (ROOM)	SAFETY GLAZING (Yes/No)
1					
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					
13					
14					
15					
16					

Total Square Footage of Window Area _____

Submission of this form is not a guarantee that the above stated windows will meet the code requirements. Final determination will be made by the Building Official at the time of inspection.



WINDOW REPLACEMENT WORKSHEET
HELP FOR THE HOMEOWNER
MOORPARK BUILDING AND SAFETY

RAY YOUNG

3/13/08

Building Official:

Date:

DATE: 1/1/08

SHEET 1 OF 3

B252

INSTRUCTIONS:

To aid in communication between yourself, the inspectors, and the plan checkers, we have prepared this sample plan to assist in the preparation of your plan for window replacement. Follow the instructions on sheets one and two, then submit this information to the Development Services Permit Center.

PREPARATION OF PLAN:

On an 8-1/2"x11" sheet of paper show the following: (Although the plan is not required to be to scale, it should be close. A scale of 1/8" per foot will work for most residences.)

1. Show the property size, configuration, street, and alley location.
2. Show all buildings and/or structures on the property.
3. Draw the floor plan of the structure. Note the use of each room. If a window will be removed or the size changed, indicate the size of the room and the size & type of all other windows in the room.
4. Show all existing windows, and note which will be replaced. (Show their size and type. This can be done by keying each location to the table as shown on the sample plan.)
5. Show size and type of the new window.

SPECIAL CASES:

Rooms are required by building code to meet minimum light and ventilation requirements. Sleeping rooms must have at least one window which meets emergency egress requirements. When making changes in size or removing windows, compliance to code requirements must be shown. (See the "Window Replacement Worksheet" for more specific details.)


Removal of Windows

1. Show room size and size of all other windows in the room. Remaining window must provide compliance to emergency egress requirements and light and ventilation requirements.

Change in Window Size

1. Reduction - Show room size and size of all other windows in the room. Remaining window must provide compliance to emergency egress, light, and ventilation requirements.
2. Increase - More information is required for this type of work. For example, widening a window may require header and shearwall retrofit, or lowering a window may weaken shearwalls in some buildings. Other types of projects require more information (framing plans, etc...) Check with a Permit Technician regarding your specific case.

SAMPLE PLAN

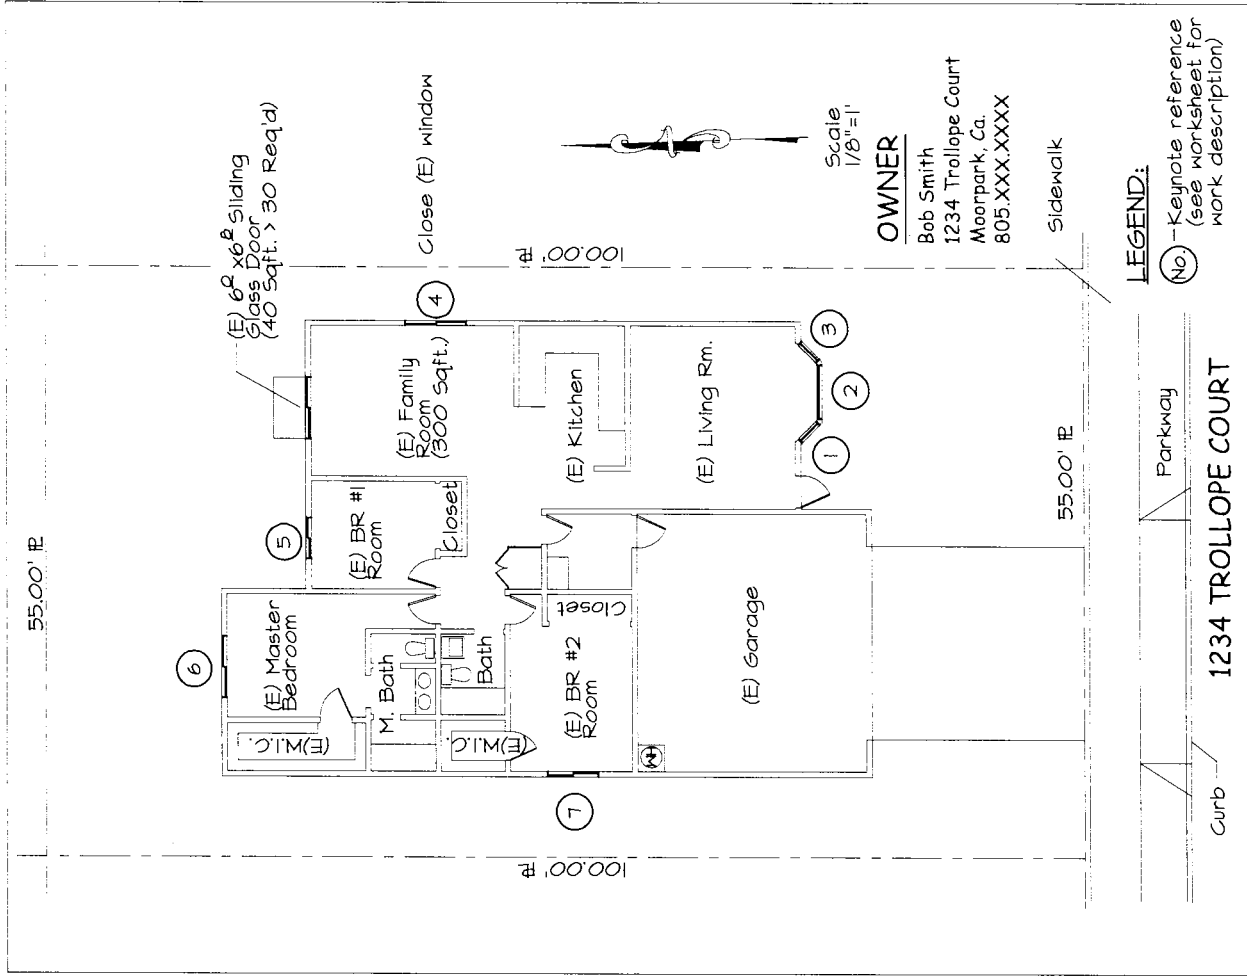

OWNER

Bob Smith
1234 Trollope Court
Moorpark, Ca.
805.XXX.XXXX

LEGEND:

(No) - Keynote reference (see worksheet for work description)

WINDOW REPLACEMENT - SAMPLE SITE PLAN

**HELP FOR THE HOMEOWNER
MOORPARK BUILDING AND SAFETY**

RAY YOUNG

Building Official:

DATE: 1/1/08

SHEET 3 OF 3

1/13/08

Date:

B252

